socomec
Innovative Power Solutions

QUICK START EN 40 - 160A (4P)

ATyS d M

Remotely Operated
Transfer Switching Equipment

Preliminary operations

Check the following upon delivery and after removal of the packaging:

- Packaging and contents are in good condition.
- The product reference corresponds to the order.
- Contents should include:
  Qty 1 x ATyS M
  Qty 1 x Emergency handle extension rod
  Qty 1 x Set of terminals
  Quick Start instruction sheet

Warning

⚠ Risk of electrocution, burns or injury to persons and / or damage to equipment.

This Quick Start is intended for personnel trained in the installation and commissioning of this product. For further details refer to the product instruction manual available on the SOCOMEC website.

- This product must always be installed and commissioned by qualified and approved personnel.
- Maintenance and servicing operations should be performed by trained and authorised personnel.
- Do not handle any control or power cables connected to the product when voltage may be, or may become present on the product, directly through the mains or indirectly through external circuits.
- Always use an appropriate voltage detection device to confirm the absence of voltage.
- Ensure that no metal objects are allowed to fall in the cabinet (risk of electrical arcing).

Failure to observe good enginering practises as well as to follow these safety instructions may expose the user and others to serious injury or death.

⚠ Risk of damaging the device

- In case the product is dropped or damaged in any way it is recommended to replace the complete product.

Accessories

- Bridging bars 125A or 160A.
- Control voltage transformer (400Vac -> 230Vac).
- Voltage sensing and power supply tap.
- Terminal shrouds.
- Additionnal aux contact block.
- Polycarbonate enclosure.
- Polycarbonate extension box.
- Dual Power Supply (DPS).
- Power Connection Terminals.
- ATS Control relay ATyS C30 + D10 or D20.
- ATS control relay ATyS C20.
- ATS control relay ATyS C40.

www.socomec.com
www.socomec.com/en/atys-d-m
To download, brochures, catalogues and technical manuals.

Printing informations: 1 color Black. White paper 90g/m².
Printing size: 420x297. Final size 210x297. This page visible first.
A separate sheet for each language.

CORPORATE HQ CONTACT:
SOCOMEC SAS, 1-4 RUE DE WESTHOUSE, 67235 BENFELD, FRANCE

542928D

Non contractual document.
Subject to change without notice.

Installation and Commissioning

STEP 1 Cabinet / Back Plate Installation
STEP 2 Connecting the POWER section
STEP 3 CONTROL / AUX POWER terminal connections
STEP 4 CHECK
STEP 5A Control by an external order (AUTO)
STEP 5B Emergency Manual Operation
STEP 5C Padlocking

STEP 1

Installation

Caution: Ensure that the product is installed on a flat rigid surface.

Recommended orientation

Recommended	Ok	Ok	Ok	Ok	Ok

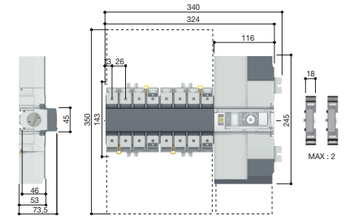

DIN RAIL
IEC 60715

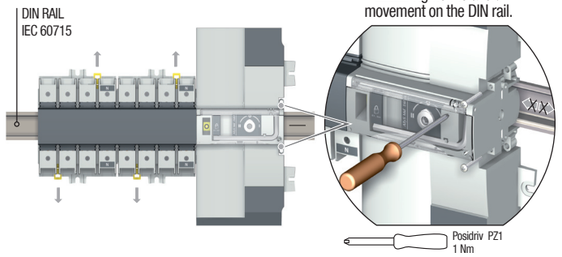

⚠ Tighten to avoid movement on the DIN rail.

Posidriv PZ1
1 Nm

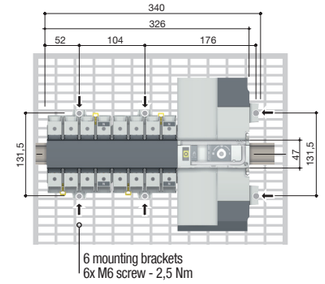

Padlocking configuration

⚠ The ATyS M is delivered with padlocking configured to the O position.



⚠ To allow padlocking in all positions (I - O - II), configure the ATyS M as follows before installation. (Screw is located at the back of the product).

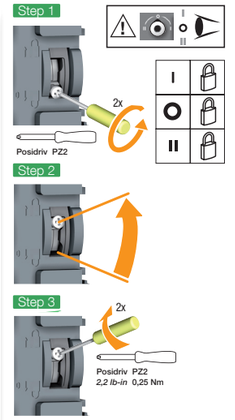

STEP 2

Power Terminal Connections

⚠ It is essential to tighten all used terminals, with cables and/or bridging bars, before use.

Source supply side

Load side bridging bar.
125A: 1309 4006
160A: 1309 4016

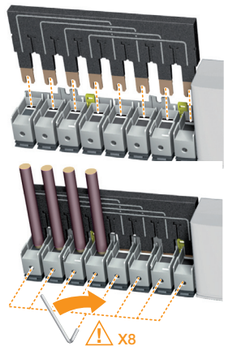

Voltage taps provide 2x ≤ 1.5mm² connections. They can be fitted in any terminals on the source supply side. Do not use on the load side when equipped with a bridging bar.

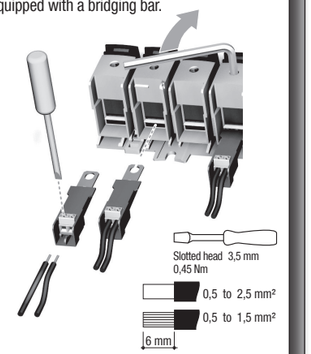

STEP 5B

Manual operation

- Open the front cover as shown to put into manual mode.
- Use the handle situated in the front panel under the cover to operate the transfer switch.
- Check the changeover switch position on the indicator before operating.

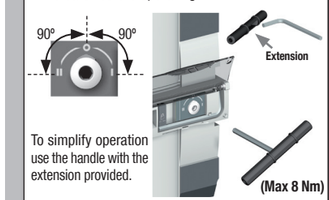

To simplify operation use the handle with the extension provided.

STEP 5C

Padlocking mode

- In order to padlock put the product in manual mode.
- Pull the locking mechanism and insert a padlock as shown.
- As standard padlocking in the 0 position. Configurable to I-0-II (see step 1).

STEP 4

Check

Whilst in manual mode, check the wiring and if ok power up the product.



STEP 5A

Automatic operation

Close the front cover as shown to put the product into automatic mode. The product is now ready to receive order inputs based on the following logic.

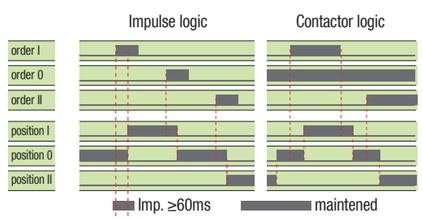

Note: Excludes position switching delays.

For contactor logic bridge contact 313 with 317.

To operate: close the contact corresponding to the desired position.



STEP 3

CONTROL / AUX POWER Terminals and wiring

Ensure that the product is in Manual Mode (front cover open).

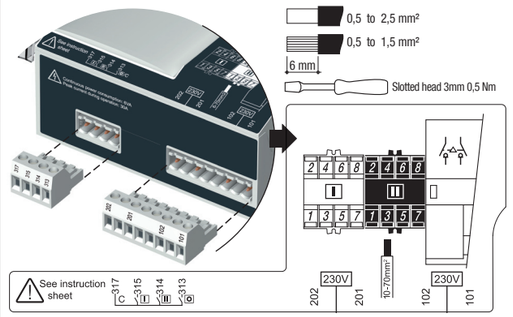

Auxiliary contacts: One module factory fitted (1309 0001).
Fitting of the 2nd AC: 1309 0001 or 1309 0011
To fit an AC, the switch must first be put in position 0. An auxiliary contact module comprises: one NO/NC changeover contact for each position (I-0-II). To install use the long screws supplied with the module.

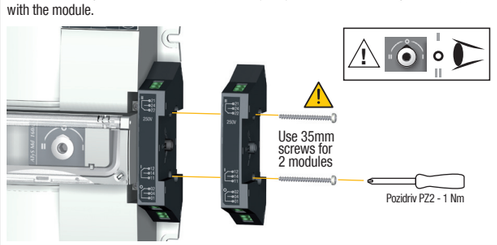

Type	Terminal no.	Description	Characteristics	Recommanded connection cross-section
Inputs	101/102	Source 1 power supply	220Vac -20% (176Vac) to 240Vac +20% (288Vac) 45 to 65Hz	0,5 to 2,5 mm² (rigid) 0,5 to 1,5mm² (stranded)
	201/202	Source 2 power supply		
	313	Position 0 order if closed with 317. Also allows control logic selection: contactor (always closed) / impulse (close to switch)	Do not connect to any power supply	
	314	Position II order if closed with 317		
	315	Position I order if closed with 317		
	317	Common control terminal for 313 to 315		
Auxiliary contacts unit.	11/12/14	Position I	Dry potential free contact 250Vac 5A AC1 24Vdc 2A	
	21/22/24	Position II		
	01/02/04	Position 0		

⚠ Control of position I and II have priority on control of position 0.